
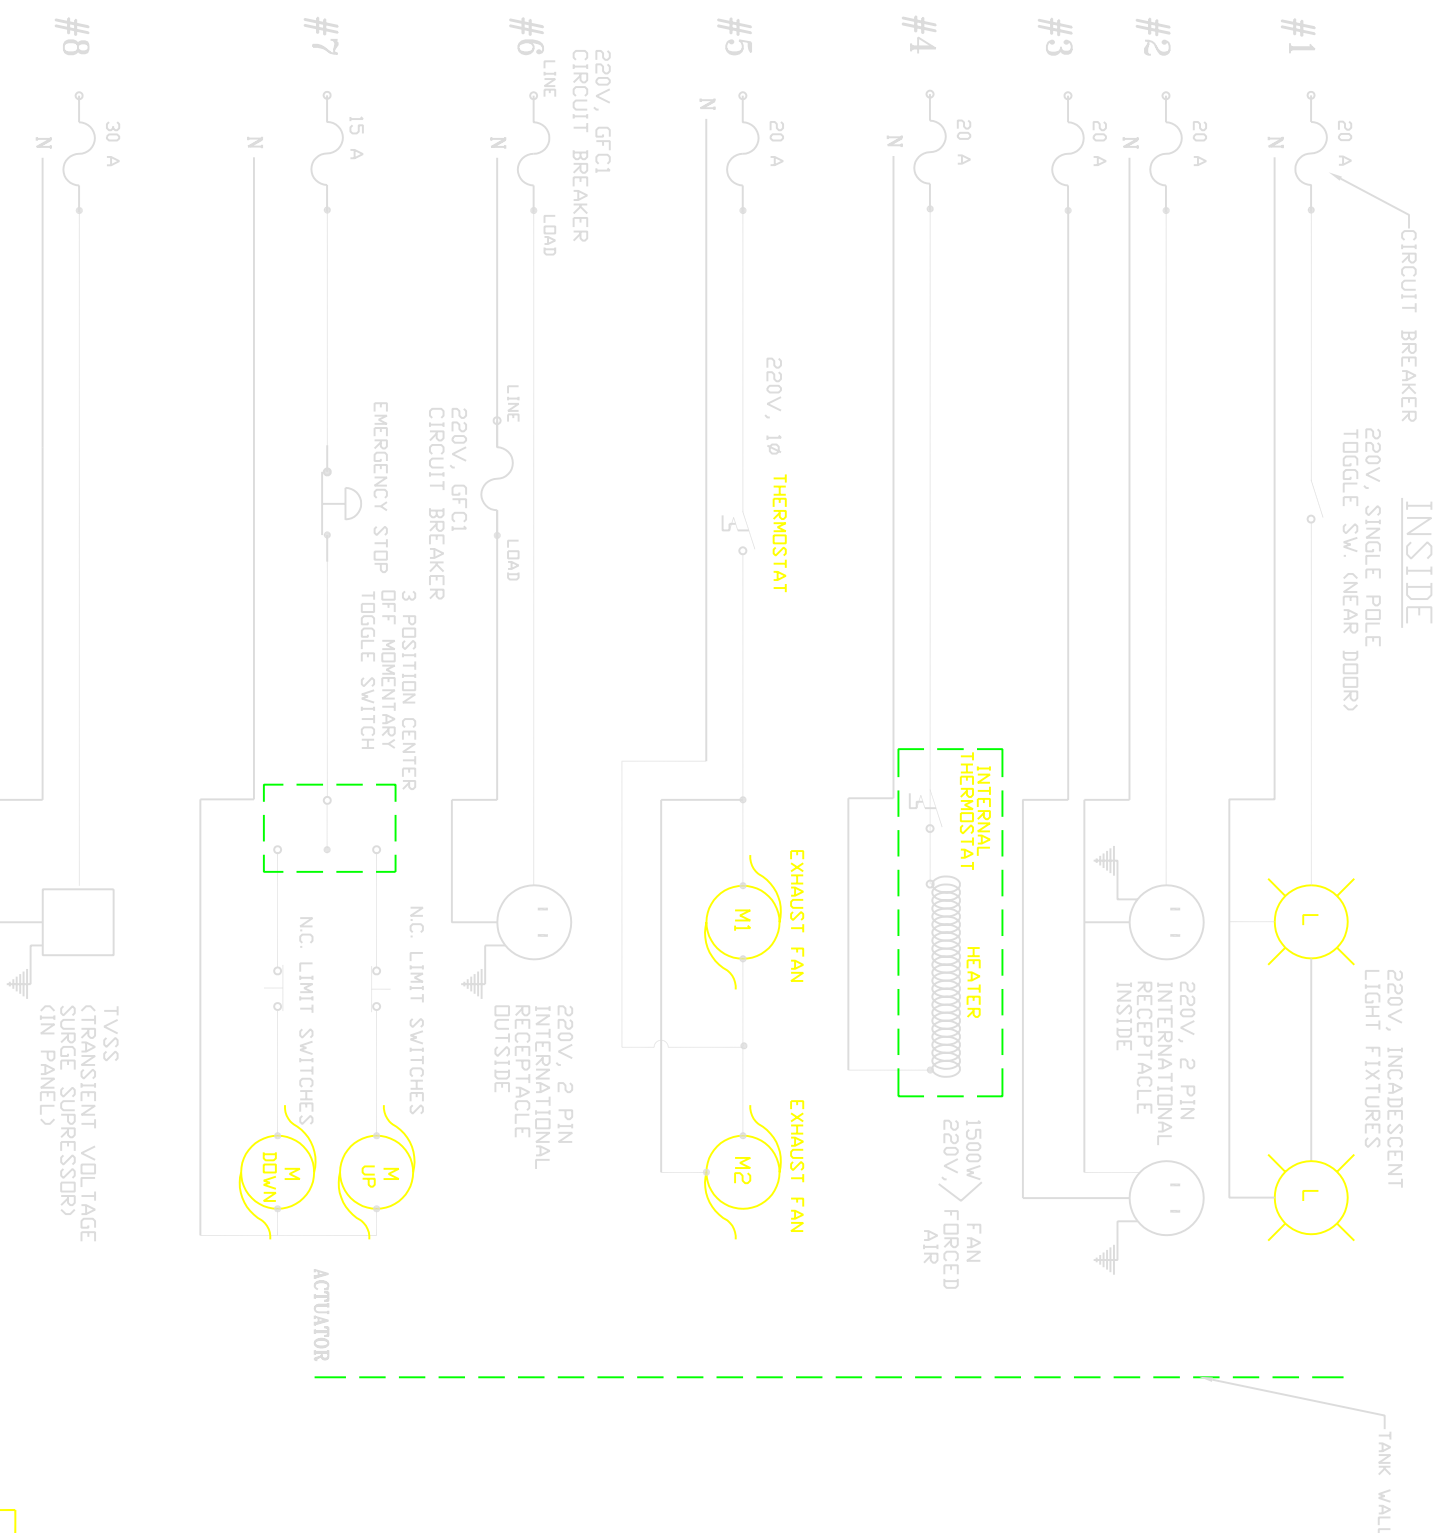


OUTSIDE
120/240 VAC
100 A
SINGLE PHASE 1 ϕ

- PANEL
- 1 - LIGHTS
 - 2 - PLUGS
 - 3 - PLUGS
 - 4 - HEATER
 - 5 - FANS
 - 6 - GFI
 - 7 - HATCH DDDR
 - 8 - SURGE SUPPRESSOR



TANK WALL

OUTSIDE

ENCLOSURE WIRING DIAGRAM LAYOUT

NOTES:
1. FOR LOCATION OF SUB-ASSEMBLY'S OR COMPONENTS ON TANK, SEE DWG. No. -0100 AND No. -0200.

FILENAME: ROTSET194017X7/94011400

PRODUCTION ORDER NO.	02-119401
CUSTOMER:	UNIVERSITY OF MICHIGAN ANN ARBOR, MICHIGAN TANK ENCLOSURE: 7'-6" DIA. x 7'-0" HT.
TITLE:	ELECTRICAL WIRING DIAGRAM
DATE	5/17/02
SCALE	NONE
DWG. NO.	9401-1400

D & R TANK CO.
1210 PROSPERITY - SE ALBUQUERQUE, NM 87105
PHONE 505/873-1101 FAX 505/877-6548
<http://www.dandr-tank.com>

REV	DATE	BY	DESCRIPTION